



CMC,
Chamarajanagar

(Annexure - 5)
Office : 08226-222035
Fax : 08226-222566
Commissioner : 08226-222566
Help Line : 08226-224239
Email : itstaff_ulb_chamarajanagar@yahoo.co.in
Website: www.chamarajanagaracity.gov.in


No.CMC/HS/SS-19/PR/53/2018-19

Date: 05-01-2019

SANITARY CERTIFICATE

This is to Certify that **J.S.S Public School** which comes under the jurisdiction of Chamaraajanagar, City Municipal Council limit, on **04-01-2019** the above said school has been inspected from our health staffs and reported that the school is having drinking water facility, toilet with proper water facility and the school premises is found clean.

This certificate is issued to the school based on their request.


SI
Commissioner
CMC, Chamaraajanagar
✂

Office of the Executive Engineer
RWS & Sanitation Dept,
Chamarajanagar Division
Chamarajanagar



☎ :Office And EE : 08226 -226054


E-mail : eedwsd.chn@gmail.com

No : EE/ RWS & SD//Cha.nagar Div/Lab/2018-19 | 1345

Date : 15/12/18

To

The Principal
JSS Public School,
Chamarajanagar.

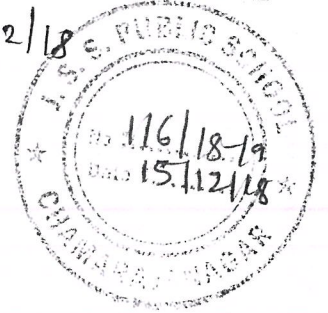

Sir,

Sub : Testing of water Samples of the JSS Pubic School Chamarajanagar
District Testing of the Water Sample.

Ref. : JSS PS/CNR/358/2018-19 Dated:12-12-2018

~~**

With reference to the above subject and reference, As per your request testing of the JSS Pubic School Chamarajanagar Town Raw Water And Drinking Samples for analysis. Test has been conducted for analysis of water samples as per Indian standard IS 10500:2012 twelve parameters in our laboratory and reports attached with the letter. So kindly collect the testing reports of samples.

Enclosed: Reports of water samples list


Your faithfully

[Signature]
Executive Engineer
RWS & Sanitation Dept,
Chamarajanagar Division,
Chamarajanagar

Water Quality Testing Report

Date : 14-12-2018

SL No	Taluk	Location	Parameters											Remarks	
			Iron	Nitrate	Fluoride	Chloride	TDS	Alkalinity	Calcium	Magnesium	Sulphate	pH	Turbidity		Hardness
1	Chamarajanagar	J.S.S. Public School, Chamarajanagar - Raw Water	0.0 to 1.0 mg/L	Upto 45 mg/L	Upto 1.5 mg/L	250-1000 mg/L	500-2000 mg/L	200-600 mg/L	75-200 mg/L	30-100 mg/L	200-400 mg/L	6.5-8.5	1-5 NTU	Upto 600 mg/L	Water Sample is Unsafe for Drinking Purpose. Because Hardness is more than Standard Value.
2		J.S.S. Public School, Chamarajanagar - Drinking Water	0.11	10	0.01	42	190	1303	520	131	86	47	7.42	0.05	672


 Executive Engineer
 RWS & Sanitation Dept,
 ChamaraJanagara Division,
 ChamaraJanagara.